

The BA484DF-F Fieldbus Display is an intrinsically safe instrument that can display up to eight fieldbus process variables. Eleven selectable standard screen formats contain one, two, three, four or eight variables, with units of measurement, tag descriptions and bargraphs on some screens.

Selectable function blocks allow the BA484DF-F fieldbus display to be used with all common system hosts. Configuration files may be downloaded from the Fieldbus Foundation or the BEKA websites

Powered by the fieldbus the BA484DF-F only requires a 2-wire connection, no additional power supply Zener barriers or galvanic isolators are required. The high contrast 86 x 45mm liquid crystal display incorporates a green backlight enabling the display to be read in all lighting conditions from full sunlight to total darkness.

Simple commissioning results from the use of standard display formats. Apart from loading the BA484DF-F configuration files onto the system host and selecting the fieldbus variables to be displayed, no programming is required. Configuration of the BA484DF-F Fieldbus Display is performed via the fieldbus and the instrument front panel push buttons.

ATEX, FM and IECEx intrinsic safety certification allows the

BA484DF-F to be installed in gas and dust hazardous areas. The two fieldbus terminals comply with the Fieldbus Intrinsic Safety Concept (FISCO) simplifying system design and documentation, although connection to non-FISCO intrinsically safe systems is possible using the entity concept.

This allows a BA484DF-F display to be directly connected to almost any hazardous fieldbus segment, provided that the segment can supply the 25mA consumed by the display.

Six optional local alarm outputs may be linked to any of the displayed variables. Each isolated single pole solid state output may be conditioned as a combined high and low alarm, or as just a high or low alarm. All the outputs comply with the requirements for *simple apparatus* allowing them to switch any certified intrinsically safe load such as a sounder, lamp or solenoid valve. Alarm configuration and the alarm set point adjustment is performed via the BA484DF-F front panel push buttons, as the local alarms are not accessible from the fieldbus system host.

Comprehensive documentation includes a FOUNDATION™ fieldbus Interface Guide.

For panel mounting applications see the BA488CF-F datasheet. This instrument has a similar electrical specification but is housed in a 144 x 72 panel mounting enclosure.

BA484DF-F FOUNDATION™ fieldbus Fieldbus display 8 variables

*Intrinsically safe for use
in gas and dust
hazardous areas*

- ◆ FOUNDATION™ fieldbus protocol.
- ◆ Compatible with most system hosts.
- ◆ High contrast display with backlight.
- ◆ Intrinsically safe
ATEX gas
or ATEX gas & dust
or FM & ATEX gas
or INMETRO
All models have
IECEx certification.
FISCO compliant.
- ◆ Six optional local alarm outputs.
- ◆ IP66 field mounting GRP enclosure.
- ◆ 3 year guarantee

www.beka.co.uk/ba484df-f




BEKA associates

BEKA associates Ltd. Old Charlton Rd.
Hitchin, Hertfordshire, SG5 2DA, U.K.
Tel. (01462) 438301 Fax (01462) 453971
e-mail sales@beka.co.uk www.beka.co.uk


SPECIFICATION

Display					
Type	120 x 64 pixel liquid crystal				
Size	86.5mm x 45mm				
Backlight	Powered from fieldbus				
Screens					
Standard format	1, 2, 3, 4 or 8 variables plus bargraph can include: units of measurement tag information				
Controls					
Front panel	Four push buttons scroll the indicator display between screens when the BA484DF-F is configured to display more variables than fit onto a single screen. Also used to configure optional local alarms.				
Fieldbus communication					
Voltage	9 to 32V (Limited by intrinsic safety parameters)				
Current	25mA				
Compliant with	IEC61158-2 31.25kbits/s Voltage Mode				
Protocol	FOUNDATION™ fieldbus				
Function blocks					
FOUNDATION™ fieldbus	1 x MAO (Multiple Analogue Output)				
or	2 x IS (Input Selector)				
	} <i>Selectable on-site</i>				
Intrinsic safety					
Europe ATEX					
Code	Group II Category 1G Ex ia IIC T5 Ga (Tamb = -40 to 60°C)				
or	Group II Category 1D Ex ia IIIC T80°C Da (Tamb = -40 to 60°C) IP66				
	} <i>Dust option, see How to order</i>				
Cert. No.	ITS04ATEX22778				
Intrinsic safety parameters	<table border="0"> <tr> <td>U_i = 17.5V</td> <td rowspan="3">} FISCO compliant</td> </tr> <tr> <td>I_i = 380mA</td> </tr> <tr> <td>P_i = 5.32W</td> </tr> </table>	U _i = 17.5V	} FISCO compliant	I _i = 380mA	P _i = 5.32W
U _i = 17.5V	} FISCO compliant				
I _i = 380mA					
P _i = 5.32W					
Location	Gas Zone 0, 1 or 2: Dust Zone 20, 21 or 22				
USA FM					
Standard	<i>Option, see How to order</i>				
Code	3610 Entity CL I, II, III: Div 1: GP A, B, C, D, E, F & G T4 @ 60°C				
File	3022546				
Standard	3611 Nonincendive				
Code	CL I: Div 2: GP A, B, C & D, T4 @ 60°C CL II, III: Div 2: GP F & G, T4 @ 60°C				
File	3022546				
International IECEx					
Code	Group II Category 1G Ex ia IIC T5 Ga (Tamb = -40 to 60°C)				
or	Group II Category 1D Ex ia IIIC T80°C Da (Tamb = -40 to 60°C) IP66				
	} <i>Dust option, see How to order</i>				
Cert. No.	IECEx ITS 05.0006				
Brazil INMETRO					
	NCC 12.0845				
Environmental					
Operating temp	-20 to 60°C (ATEX gas certification -40 to 60°C)				
Storage temp	-40 to 85°C				
Humidity	To 95% @ 40°C				
Enclosure	IP66				
EMC	In accordance with EU Directive 2004/108/EC				
Immunity	BS EN 61326:1998 Operates normally with conducted 3Vrms interference between 0.15kHz and 80MHz, or radiated 10V/m interference between 80MHz and 1GHz.				
Emissions	CISPR16-1/2 Class A				
Mechanical					
Terminals	Screw clamp for 0.5 to 1.5mm ² cable.				
Weight	1.6kg				
Accessories					
Alarms	Six galvanically isolated outputs which may be linked to displayed variables. Each alarm is configurable from instrument push buttons as: combined high and low alarm high or low alarm				
	Note: Alarms are not accessible from the fieldbus system host				

DIMENSIONS (mm)

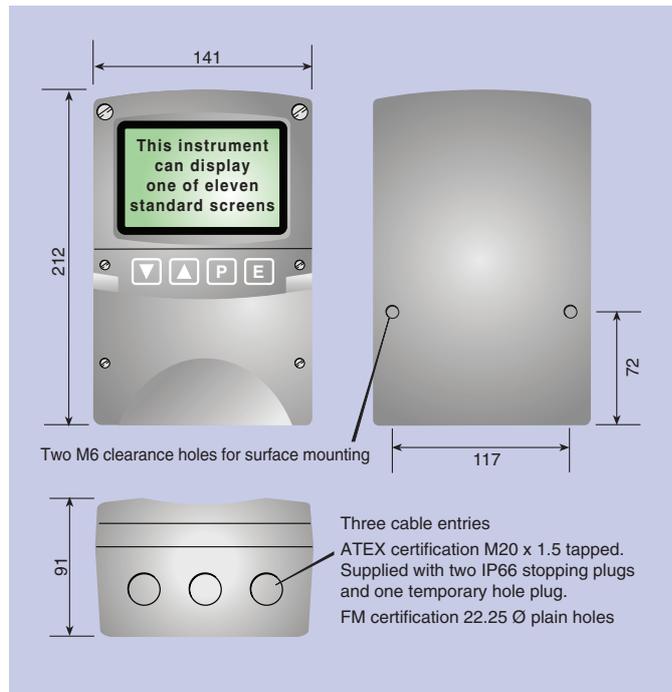

TERMINAL CONNECTIONS

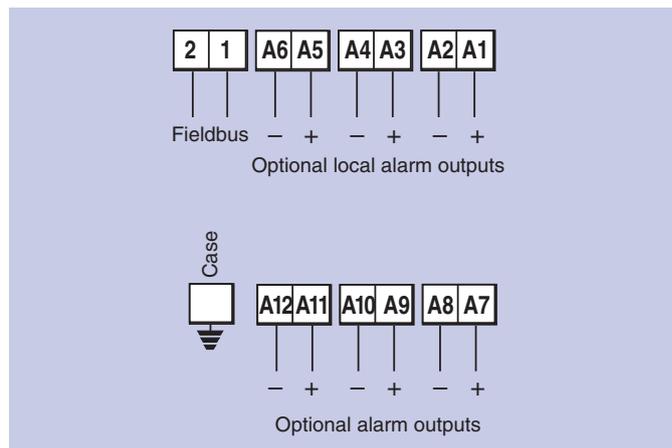

Contacts	Isolated single pole solid state switch certified as simple apparatus. Ron less than 5Ω + 0.7V Roff greater than 1MΩ
Intrinsic safety parameters	U _i = 28Vdc I _i = 200mA P _i = 0.84W
Tag strip	Printed legend behind the display window
Tag plate	Engraved stainless steel plate attached to the side of the instrument.
Pipe mounting kit	BA392D or BA393
FOUNDATION™ fieldbus interface guide	May be downloaded from www.beka.co.uk

HOW TO ORDER

Model number	BA484DF-F	} <i>All models have IECEx certification. Note: Cable entries differ for FM & ATEX models</i>
Certification	ATEX gas	
or	ATEX gas & dust	
or	FM & ATEX gas	
or	INMETRO gas	
or	INMETRO gas & dust	
Accessories		Please specify if required
Six alarms	Alarms	
Tag strip	Tag strip legend	
Tag plate	Tag plate legend	
Pipe mounting kit	BA392D or BA393	